


WALL OPENING 460x325 MAX. ACTUAL SIZE TO BE FORMED TO SUIT DUCT ENTRIES. VOIDS TO BE SEALED AND SURFACES MADE GOOD WITH CLASS 1 MORTAR.


NOTES:

1. This design is subject to EirGrid design approval.
2. This drawing is to be read in conjunction with all other relevant documentation.
3. Dimensions are in millimeters, unless noted otherwise.
4. Drawings are not to be scaled use figured dimensions only.
5. All material and workmanship to be in accordance with the NRA./TII specification for Roadworks, May 2005 and subsequent revisions.
6. Reinforced concrete to be a minimum grade C32/40, Sulphate resisting cement to be used where aggressive soil conditions apply.
7. Carriageway covers and frames to be to B.S. 124.
8. All covers to have ESB logo incorporated in them to the approval of EirGrid.
9. Brickwork to be class B Engineering, beds and Joints to be Class 1 mortar.
10. Final position of Link Box to be agreed with EirGrid prior to installation.
13. In a forest environment backfill with lean mix outside the cover frame.

Link Box Chamber Detail - Plan
SCALE 1:20

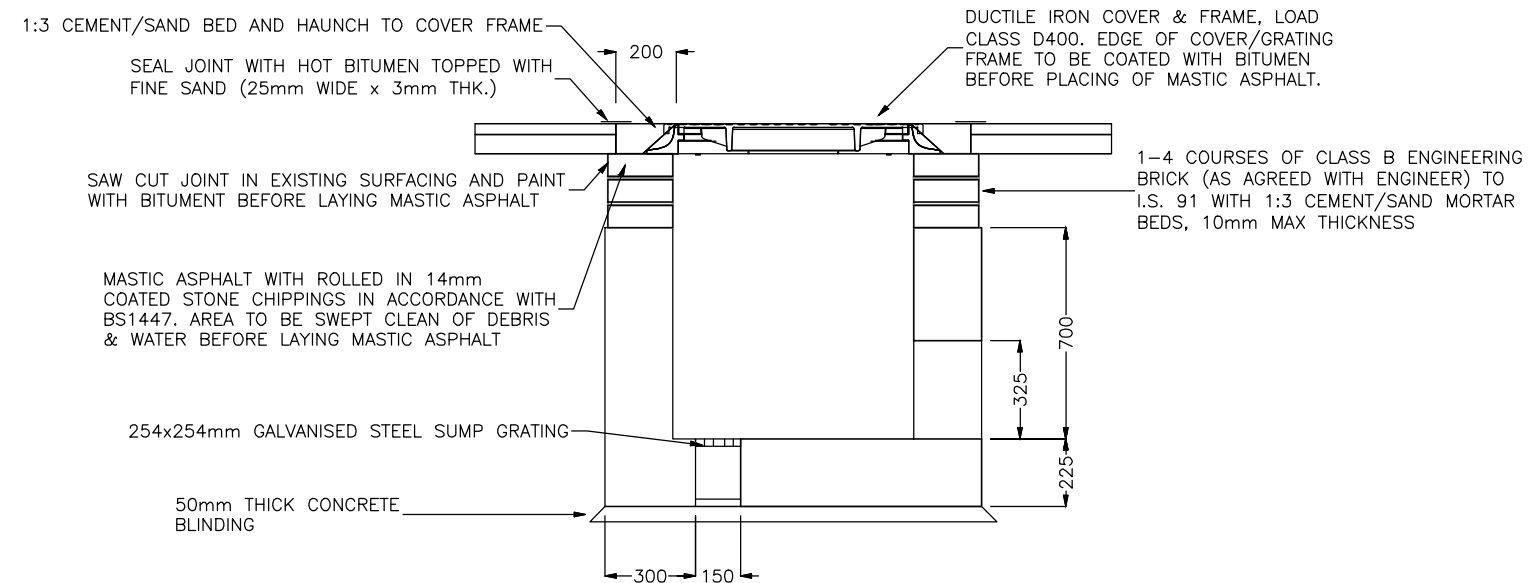

Link Box Chamber Detail - Section A-A
SCALE 1:20

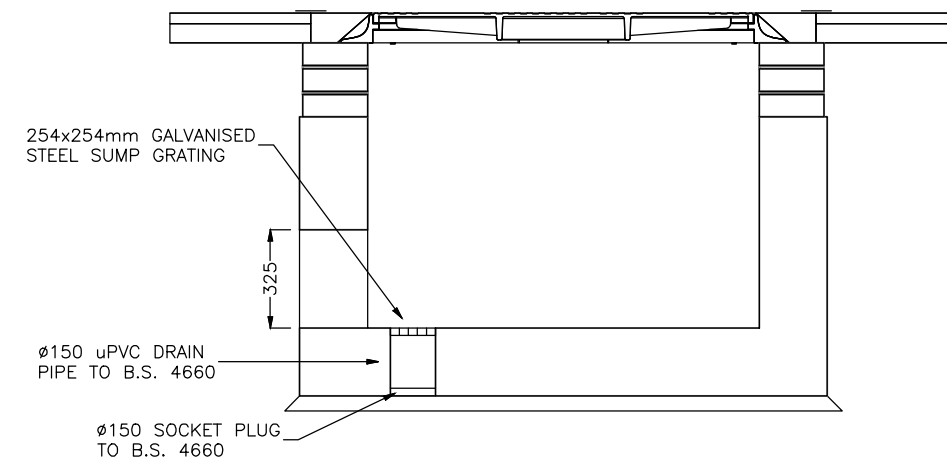

Link Box Chamber Detail - Section B-B
SCALE 1:20



Head Office
Beenreigh,
Abbeydorney,
Tralee, Co. Kerry
Ireland
Tel: 00353 66 7135710

CLIENT



PROJECT

Castlebanny Wind Farm
110kV Grid Connection

PROJECT NUMBER
05-699

SHEET NUMBER
05699-DR-103

SHEET TITLE

Typical Link Box
Chamber Details

DRAWING STATUS
For Planning

ISSUE/REVISION

I/R	DATE	DESCRIPTION
P01	02.12.20	Issued for Planning
P00	03.09.20	Issued for Information